


CABLING DIAGRAM – 02-0109-XX/02-0111-XX VIDEO 3G 1000 NAMES WITH KEY SAFE INTEGRATED

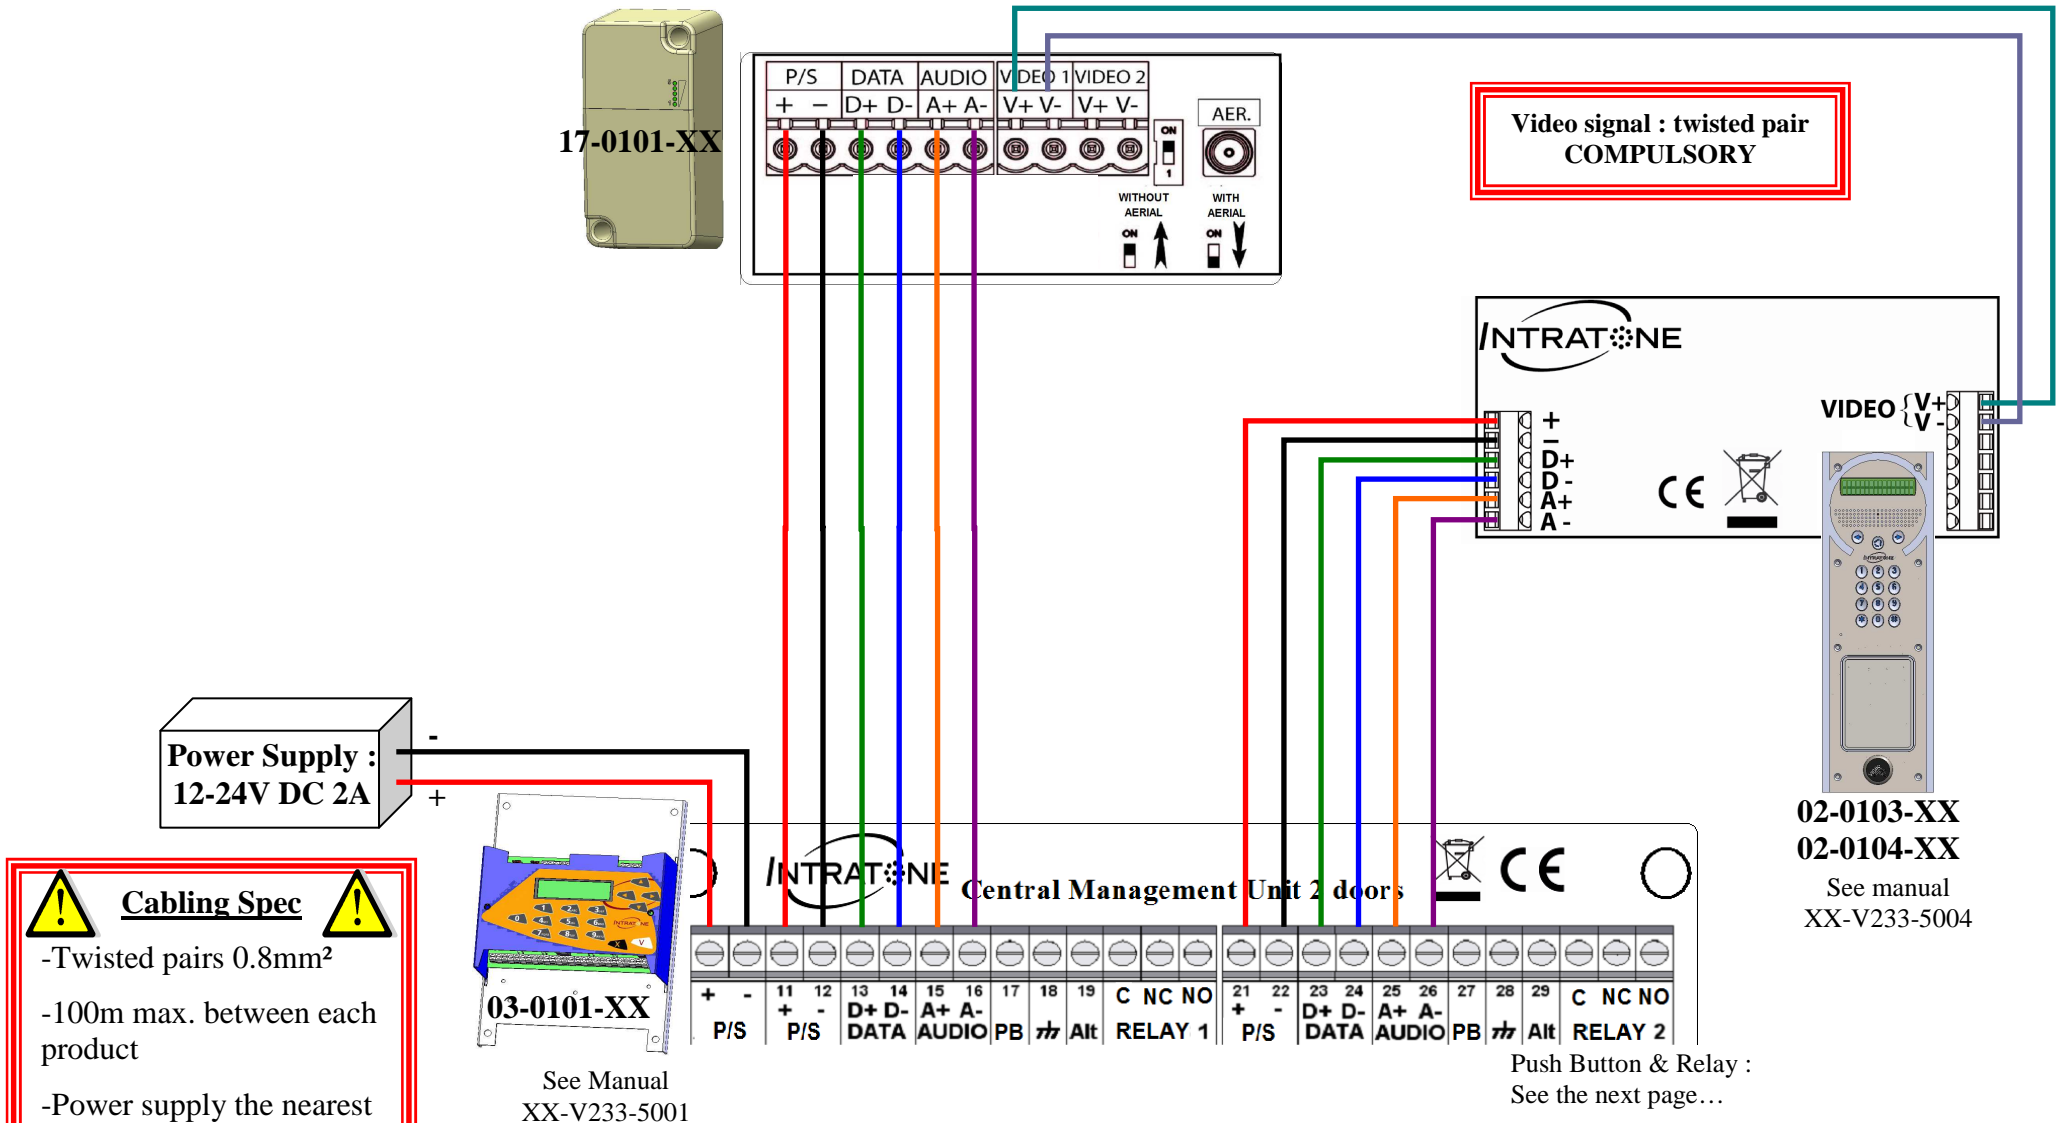


! Cabling Spec !

- Twisted pairs 0.8mm²
- 100m max. between each product
- Power supply the nearest to the central unit.

Cabling Diagram – 02-0109-XX or 02-0111-XX

NUMBER OF PAIRS

Bornes	Details	Nb Pairs
+ / -	Power Supply	1
D+ / D-	Data Bus	1 twisted
A+ / A-	Audio Bus	1 twisted : compulsory
V+ / V-	Video Bus	1 twisted : compulsory
Alt / Ground	Alert management	1
BP / Ground	Push Button	1
C / NC / NO	Relay	1

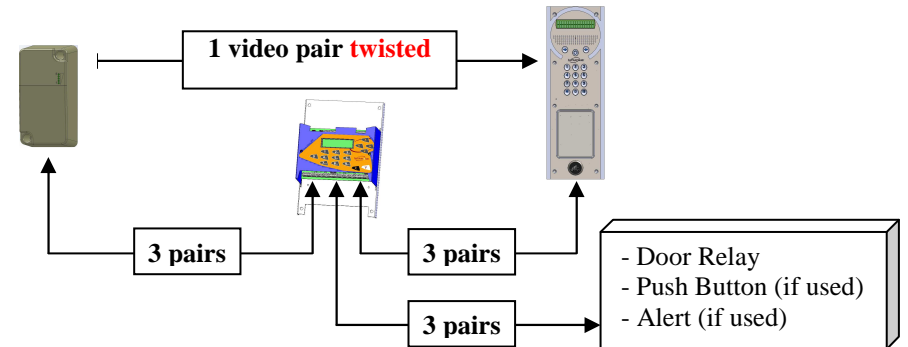

WIRING – ALERT ENTRY / EXIT PUSH BUTTON & ACCESS DOOR

Alert Management :
It sends an automatic mail thanks to a NO or NC dry contact input ,
You can set it up on the website :
www.intratone.com in the "management website" tab.

Magnet Lock

Electric Lock

- Maximum allowed electrical supply on your relays :
42V-AC or 60V-DC
- Protection Varistor for the relays :
included and calibrated of 12V
It must be cabled the nearest to the central.
- : Power Supply of the lock